

DOWNTOWN DISTRICT APPLICATION - SEE NOTE (1)


NOTE:

(1) WHERE STREET LIGHTS AND/OR STREET TREES ARE PROPOSED, A MINIMUM CLEAR DISTANCE OF 10'-0" SHALL BE MAINTAINED BETWEEN THE CENTER OF THE STREET TREE TRUNK AND THE CENTER OF THE STREET LIGHT LUMINAIRE. DESIGNER SHALL COMPLY WITH THE "DOWNTOWN STREETScape STANDARDS".

(2) WHERE STREET LIGHTS AND/OR STREET TREES ARE PROPOSED, A MINIMUM CLEAR DISTANCE OF 10'-0" SHALL BE MAINTAINED BETWEEN THE OUTER EDGE OF THE STREET TREE MATURE CANOPY AND THE CENTER OF THE STREET LIGHT LUMINAIRE.

CLEARANCE TO STREET LIGHT POLES:

ALL PROPOSED AND EXISTING STREET TREES SHALL BE MAINTAINED AS PER THE "TREE PRUNING STANDARDS" INDICATED IN THE "DOWNTOWN STREETScape STANDARDS" REFERENCED IN THE "CITY OF COLUMBUS DOWNTOWN STREET LIGHT MASTERPLAN".

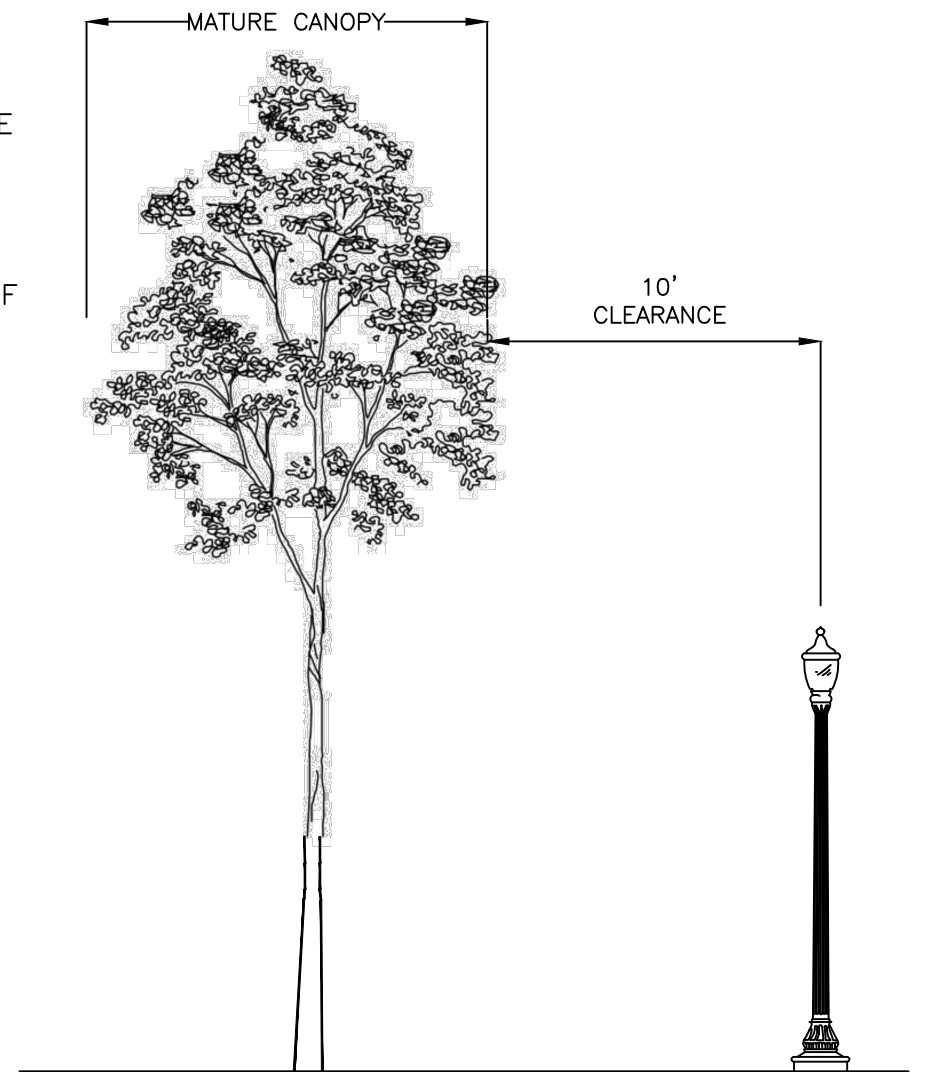

URBAN AND RURAL APPLICATION - SEE NOTE (2)

MIS-201	CITY OF COLUMBUS, OHIO DEPT. OF PUBLIC UTILITIES - DIVISION OF POWER	
	MINIMUM TREE CLEARANCE FOR DOWNTOWN, URBAN, & RURAL AREAS	
	DRAWN BY: John	DATE: 12/21/16
	APPROVED: <i>James M. [Signature]</i>	
SCALE:	SHEET: 10F1	